EZ-ZONE® PM Express Users Manual

PID Controller

TOTAL CUSTOMER SATISFACTION 3 Year Warranty

ISO 9001 Registered Company Winona, Minnesota USA

WATLOW

1241 Bundy Boulevard., Winona, Minnesota USA 55987
Phone: +1 (507) 454-5300, Fax: +1 (507) 452-4507 http://www.watlow.com

0600-0065-0000 Rev. C Made in the U.S.A.

May 2009

1 2 3 4

Safety Information

We use note, caution and warning symbols throughout this book to draw your attention to important operational and safety information.

A "NOTE" marks a short message to alert you to an important detail.

A "CAUTION" safety alert appears with information that is important for protecting your equipment and performance. Be especially careful to read and follow all cautions that apply to your application.

A "WARNING" safety alert appears with information that is important for protecting you, others and equipment from damage. Pay very close attention to all warnings that apply to your application.

The electrical hazard symbol, ⚠ (a lightning bolt in a triangle) precedes an electric shock hazard CAUTION or WARNING safety statement. Further explanations follow:

Symbol	Explanation
	CAUTION – Warning or Hazard that needs further explanation than label on unit can provide. Consult users manual for further information.
	ESD Sensitive product, use proper grounding and handling techniques when installing or servicing product.
	Unit protected by double/reinforced insulation for shock hazard prevention.
	Do not throw in trash, use proper recycling techniques or consult manufacturer for proper disposal.
	Unit can be powered with either alternating current (ac) voltage or direct current (dc) voltage.

c UL us LISTED PROCESS CONTROL EQUIPMENT	Unit is a Listed device per Underwriters Laboratories®. It has been evaluated to United States and Canadian requirements for Process Control Equipment. UL 61010 and CSA C22.2 No. 61010. File E185611 QUYX, QUYX7. See: www.ul.com
c UL us LISTED PROC. CONT. EQ. FOR HAZARDOUS LOCATIONS	Unit is a Listed device per Underwriters Laboratories®. It has been evaluated to United States and Canadian requirements for Hazardous Locations Class 1 Division II Groups A, B, C and D. ANSI/ISA 12.12.01-2007. File E184390 QUZW, QUZW7. See: www.ul.com
CE	Unit is compliant with European Union directives. See Declaration of Conformity for further details on Directives and Standards used for Compliance.
FM APPROVED	Unit has been reviewed and approved by Factory Mutual as a Temperature Limit Device per FM Class 3545 standard. See: www.fmglobal.com
CSA	Unit has been reviewed and approved by CSA International for use as Temperature Indicating-Regulating Equipment per CSA C22.2 No. 24. See: www.csa-international.org

Warranty

The EZ-ZONE® PM is manufactured by ISO 9001-registered processes and is backed by a three-year warranty to the first purchaser for use, providing that the units have not been misapplied. Since Watlow has no control over their use, and sometimes misuse, we cannot guarantee against failure. Watlow's obligations hereunder, at Watlow's option, are limited to replacement, repair or refund of purchase price, and parts which upon examination prove to be defective within the warranty period specified. This warranty does not apply to damage resulting from transportation, alteration, misuse or abuse. The purchaser must use Watlow parts to maintain all listed ratings.

Technical Assistance

If you encounter a problem with your Watlow controller, review your configuration information to verify that your selections are consistent with your application: inputs, outputs, alarms, limits, etc. If the problem persists, you can get technical assistance from your local Watlow representative (see back cover), by e-mailing your questions to wintechsupport@watlow.com or by dialing +1 (507) 494-5656 between 7 a.m. and 5 p.m., Central Standard Time (CST). Ask for an Applications Engineer. Please have the following information available when calling:

- Complete model number
- All configuration information
- User's Manual
- Factory Page

Return Material Authorization (RMA)

1. Call Watlow Customer Service, (507) 454-5300, for a Return Material Authorization (RMA) number before returning any item for repair. If you do not know why the product failed, contact an Application Engineer or Product Manager.

The EZ-ZONE PM Controller User's Manual is copyrighted by Watlow Winona, Inc., © December 2008 with all rights reserved. The EZ-ZONE PM is covered by U.S. Patent No. 6,005,577 and Patents Pending

Overview

The EZ-ZONE PM controllers take the pain out of solving your thermal loop requirements while reducing the cost of control-loop ownership. You can order this control as a single loop PID controller with a high-amperage power output in either a 16th or 32nd DIN panel-mount package.

It just got a whole lot easier to solve the thermal requirements of your system. Because the EZ-ZONE family of controls are highly scalable where you pay only for what you need. So if you are looking for a single or multi-loop PID controller, an over-under limit controller or an integrated controller (PID and Limit), the EZ-ZONE family of controls can meet all of your needs. Point your browser to http://www.watlow.com to find out more about the EZ-ZONE family of controls.

For this particular control, serial communications is accomplished using Watlow's Standard Bus protocol. If the need arises to network your controls and communicate using other popular protocols such as Modbus RTU/TCP®, EtherNet/IP™ or DeviceNet™, consider using the EZ-ZONE family Remote User Interface/Gateway (RUI/GTW).

Installation and Wiring

Dimensions 1/32 DIN

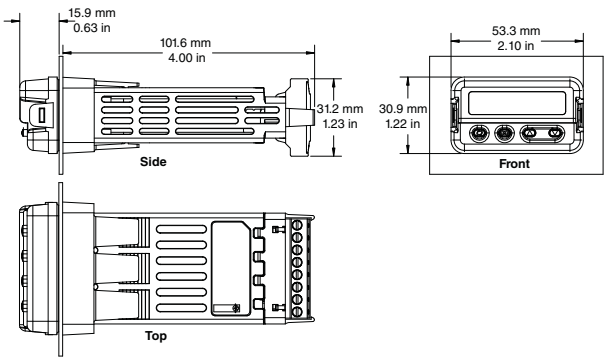

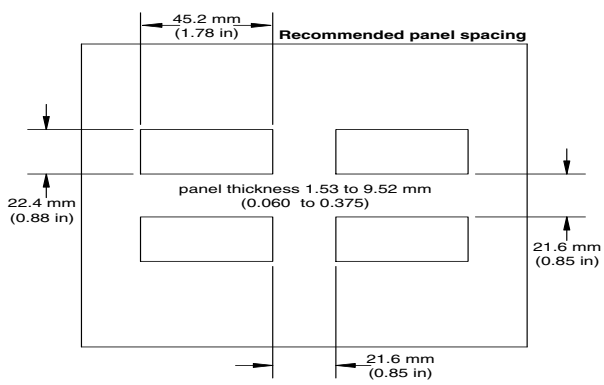

1/32 DIN Maximum Cutout

Dimensions 1/16 DIN

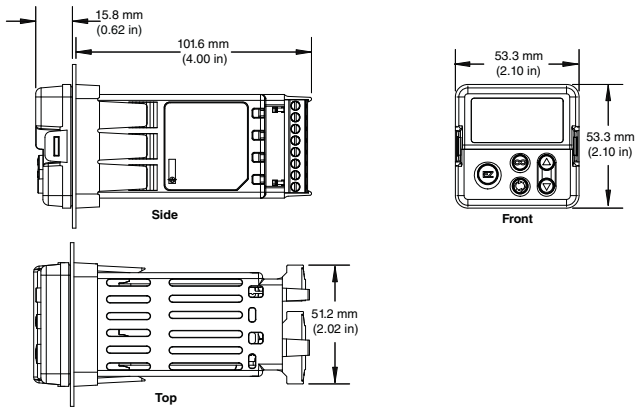

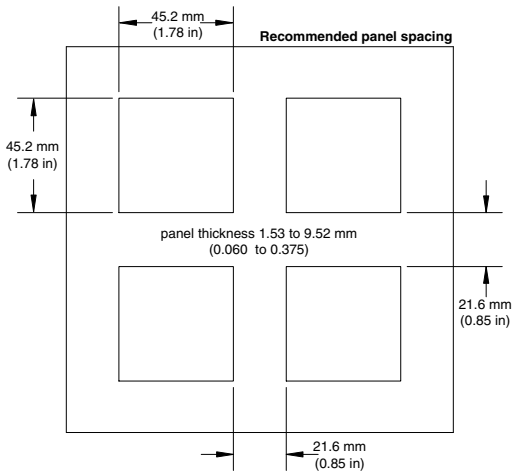

Installation

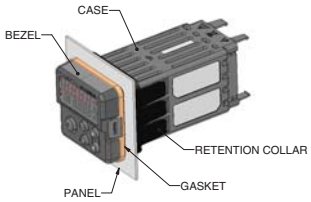

1. Make the panel cutout using the mounting template dimensions in this chapter. Insert the case assembly into the panel cutout.
2. While pressing the case assembly firmly against the panel, slide the mounting collar over the back of the controller.

If the installation does not require a NEMA 4X seal, slide the mounting collar up to the back of the panel tight enough to eliminate the spacing between the gasket and the panel.

Slide the mounting collar over the back of the controller.

Place the blade of a screwdriver in the notch of the mounting collar assembly.

3. For a NEMA 4X seal, place the blade of a screwdriver in the notch of the mounting collar assembly and push toward the panel while applying pressure to the face of the controller. Don't be afraid to apply enough pressure to properly install the controller.
   The seal system is compressed more by mating the mounting collar tighter to the front panel (see picture). If you can move the case assembly back and forth in the cutout, you do not have a proper seal. The tabs on each side of the mounting collar have teeth that latch into the ridges on the sides of the controller. Each tooth is staggered at a different depth from the front so that only one of the tabs, on each side, is locked onto the ridges at a time.



Removing the Mounted Controller from Its Case

1. From the controller's face, pull out the tab on each side until you hear it click.

Pull out the tab on each side until you hear it click.

Grab the unit above and below the face and pull forward.

2. Once the sides are released, grab the unit above and below the face with two hands and pull the unit out. If it is difficult to pull the unit out, remove the connectors from the back of the controller. This should make it easier to remove.

⚠ Warning:

All electrical power to the controller and controlled circuits must be disconnected before removing the controller from the front panel or disconnecting other wiring. Failure to follow these instructions may cause an electrical shock and/or sparks that could cause an explosion in class 1, div. 2 hazardous locations.

Returning the Controller to its Case

1. Ensure that the orientation of the controller is correct and slide it back into the housing.
2. Using your thumbs push on either side of the controller until both latches click.

Note:
The controller is keyed so if it feels that it will not slide back in do not force it. Check the orientation again and reinsert after correcting.

Chemical Compatibility

This product is compatible with acids, weak alkalis, alcohols, gamma radiation and ultraviolet radiation.
This product is not compatible with strong alkalis, organic solvents, fuels, aromatic hydrocarbons, chlorinated hydrocarbons, esters and keytones.

Terminal Definitions

Slot C	Terminal Function	Model
98 99	power input: ac or dc+ power input: ac or dc-	PM _(C)_ _ _ - AAAAB _ _
CF CD CE	Standard Bus EIA-485 common Standard Bus EIA-485 T-/R- Standard Bus EIA-485 T+/R+	PM _(C)_ _ _ - AAAAB _ _
Slot A		
Input 1		
T1 S1 R1	S2 (RTD) or current +, S3 (RTD), thermocouple -, current - or volts - S1 (RTD), thermocouple + or volts +	Universal Sensor input 1: all configurations
Outputs	**Terminal Function**	**Configuration**
1 2		
X1 W1 Y1	common (Any switched dc output can use.) dc- (open collector) dc+	Switched dc/open collector, output 1: PM _(C)_ C _-_ AAAB _ _
W2 Y2	dc- dc+	Switched dc, output 2: PM _ (C) _ _ C - _ AAAB _ _
F1 G1 H1	voltage or current - voltage + current +	Universal Process, output 1: PM _ (C) _ F _ - _ AAAB _ _
L1 K1 J1	normally open common normally closed	Mechanical Relay 5 A, Form C, output 1: PM _(C)_ E _-_ AAAB _ _
L2 K2	normally open common	NO-ARC 15 A, Form A, output 2: PM6(C) _ _ H - _ AAAB _ _
L2 K2	normally open common	Mechanical Relay 5 A, Form A, output 2: PM _(C)_ _ J-_ AAAB _ _
L1 K1	L2 K2	normally open common	Solid-State Relay 0.5 A, Form A output 1: PM _(C)_ K _ - _ AAAB _ _ output 2: PM _(C)_ _ K - _ AAAB _ _

Note:
In the pictures below notice that the Slot A connector does not show labeling for the outputs. Labeling for Slot A outputs is based on the controller part number.



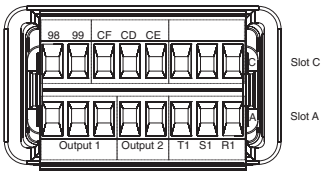

⚠ Warning:

Use National Electric (NEC) or other country-specific standard wiring and safety practices when wiring and connecting this controller to a power source and to electrical sensors or peripheral devices. Failure to do so may result in damage to equipment and property, and/or injury or loss of life.

Note:
Maximum wire size termination and torque rating:
- 0.0507 to 3.30 mm² (30 to 12 AWG) single-wire termination or two 1.31 mm² (16 AWG)
- 0.8 Nm (7.0 lb.-in.) torque

Note:
Adjacent terminals may be labeled differently, depending on the model number.
Note:
To prevent damage to the controller, do not connect wires to unused terminals.
Note:
Maintain electrical isolation between analog input 1 and switched dc/open collector outputs.

Power



- 47 to 63 Hz
- 10VA maximum power consumption

Low Power

- 12 to 40V⎓ (dc)
- 20 to 28V~ (ac) Semi Sig F47

High Power

- 85 to 264V~ (ac)
- 100 to 240V~ (ac) Semi Sig F47

Note:
In the drawings below for each input notice that the Slot A connector labeling is identified.

Note:
When using a 2 wire RTD, jumper S1 and T1 together

Inputs
All inputs shown below represent input 1 (the only input) and are to be connected to slot A of the PID Control.

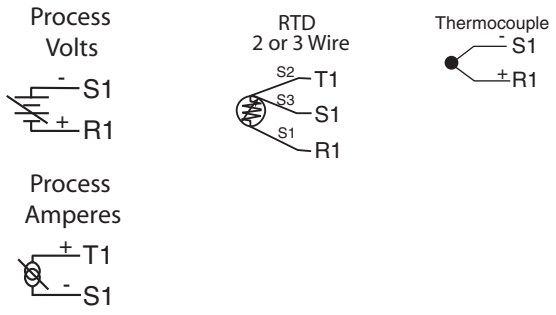

Process Volts and Amperes
- 4 to 20 mA @ 100 Ω input impedance
- 0 to 10V⎓ (dc) @ 20 kΩ input impedance
- Scalable

Resistance Temperature Detector (RTD)
- Platinum, 100 Ω @ 0°C
- Calibration to DIN curve (0.00385 Ω/Ω/°C)
- 20 Ω total lead resistance
- RTD excitation current of 0.09 mA typical. Each ohm of lead resistance may affect the reading by 0.03°C.
- For 3-wire RTDs, the S1 lead must be connected to R1.
- For best accuracy use a 3-wire RTD to compensate for lead-length resistance. All three lead wires must have the same resistance.

Thermocouple
- 2 KΩ maximum source resistance
- >20 MΩ input impedance
- 3 microampere open-sensor detection
- Thermocouples are polarity sensitive. The negative lead must be connected to S1.
- To reduce errors, the extension wire for thermocouples must be of the same alloy as the thermocouple.

Power Supply Note:
Switched dc and Process outputs use a common power supply with a maximum current output of 40mA. As an example, supplied current (mA) from output 1 and 2 can be 20/20, 30/10, 40/0, 10/30, etc...

Outputs
Please note all outputs are connected exclusively to slot A. Output availability is based on the part number of your PID Control.

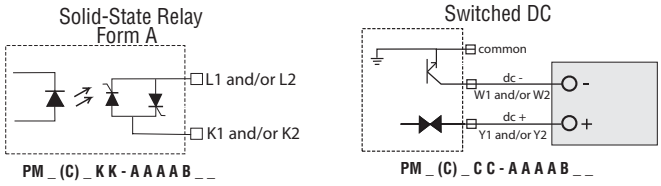

PM _ (C) _ K K - A A A A B _ _

PM _ (C) _ C C - A A A A B _ _

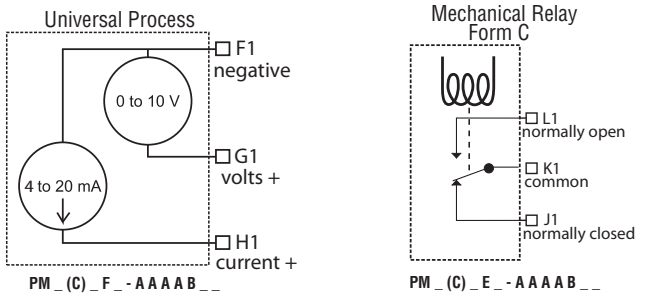

PM _ (C) _ F _ - A A A A B _ _

PM _ (C) _ E _ - A A A A B _ _

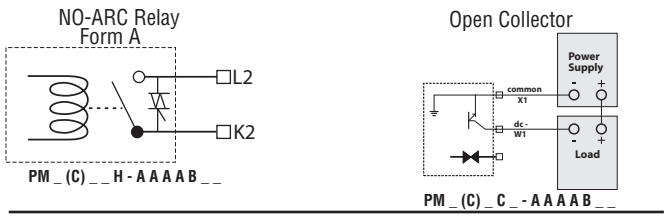

PM _ (C) _ _ H - A A A A B _ _

PM _ (C) _ C _ - A A A A B _ _



PM _ (C) _ _ J - A A A A B _ _

Quencharc Note:
Switching pilot duty inductive loads (relay coils, solenoids, etc.) with the mechanical relay, solid state relay or open collector output options requires use of an R.C. suppressor.

Switched DC
- Supplied current up to a maximum of 40 mA. See Power Supply note above.
- Short circuit limited to <50 mA
- 22 to 32V⎓ (dc) open circuit voltage
- Use dc- and dc+ to drive external solid-state relay.
- DIN-A-MITE compatible
  - single-pole: up to 4 in parallel or 4 in series
  - 2-pole: up to 2 in parallel or 2 in series
  - 3-pole: up to 2 in series

Open Collector
- 100 mA maximum output current sink
- 30V⎓ (dc) maximum supply voltage
- Any switched dc output can use the common terminal.
- Use an external power supply to control a dc load, with the load positive to the positive of the power supply, the load negative to the open collector and common to the power supply negative.

See Quencharc note.

Mechanical Relay Form C
- 5 A at 240V~ (ac) or 30V⎓ (dc) maximum resistive load
- 20 mA at 24V minimum load
- 125 VA pilot duty at 120/240V~ (ac), 25 VA at 24V~ (ac)
- 100,000 cycles at rated load
- Output does not supply power.
- For use with ac or dc

See Quencharc note.

Mechanical Relay Form A
- 5 A at 240V~ (ac) or 30V⎓ (dc) maximum resistive load
- 20 mV at 24V minimum load
- 125 VA pilot duty @ 120/240V~ (ac), 25 VA at 24V~ (ac)
- 100,000 cycles at rated load
- Output does not supply power.
- For use with ac or dc

See Quencharc note.

NO-ARC Relay Form A
- 15 A at 85 to 264V~ (ac) resistive load only
- 1/16 DIN models only
- 2,000,000 cycle rating for NO-ARC circuit
- 100 mA minimum load
- 2 mA maximum off state leakage
- Do not use on dc loads.
- Output does not supply power.

Solid-State Relay Form A
- 0.5 A at 20 to 264V~ (ac) maximum resistive load
- 20 VA 120/240V~ (ac) pilot duty
- Opto-isolated, without contact suppression
- Maximum off state leakage of 105 microamperes
- Output does not supply power
- Do not use on dc loads.
- See Quencharc note.

Universal Process
- 4 to 20 mA into 800 Ω maximum load
- 0 to 10V⎓ (dc) into voltage 1 kΩ minimum load
- Scalable
- Output supplies power (See Power Supply note above).
- Cannot use voltage and current outputs at same time

Keys & Displays
16th DIN PID Controller

Zone Display:
When `ZonE` (found in the Factory Page) is set to on, indicates the controller zone.
`1` to `9` = zones 1 to 9
`A` = zone 10 `E` = zone 14
`b` = zone 11 `F` = zone 15
`C` = zone 12 `h` = zone 16
`d` = zone 13

Upper Display:
In the Operations Menu, displays the process value, otherwise displays the value of the parameter in the lower display.

Temperature Units Indicator Lights:
Indicates whether the temperature is displayed in Fahrenheit or Celsius.

Output Activity:
Number lights indicate activity of outputs 1 and 2.

Percent Units Indicator:
Lights when the controller is displaying values as a percentage or when the open-loop set point is displayed.

Communications Activity:
Flashes when another device is communicating with this controller.

Lower Display:
Indicates the set point or output power value during operation, or the parameter whose value appears in the upper display.

A/M Key:
This key will toggle the control mode between the current value of the C.M prompt (Off, MAn, AUto) and Manual when the A/M button is pushed and held for 3 seconds.

Infinity Key:
Clears and Silences alarms, press to back up one level, or press and hold for two seconds to return to the Operations Menu.

Advance Key:
Advances through parameter prompts.

Up and Down Keys:
In the Operations Menu, adjusts the set point in the lower display. In other pages, changes the upper display to a higher or lower value, or changes a parameter selection.

32nd DIN PID Controller

With a few exceptions, all of the key functions described for the 16th DIN PID Controller apply to the 32nd DIN PID Controller as well.

Left Display:
In the Operations Menu, displays the process value, otherwise displays the value of the parameter in the left display.

Right Display:
Indicates the set point or output power value during operation, or the parameter whose value appears in the right display.

Responding to a Displayed Message (16th or 32nd DIN)

An active message will cause the display to toggle between the normal settings and the active message in the upper or left display and [Attn] in the lower or right display. Your response will depend on the message and the controller settings. Some messages, such as Tuning, indicate that a process is underway. If a message is generated in the right or lower display that can be cleared (such as `AL.h 1`), simply push the infinity key to execute the action (`CLr`).

`AL.L 1`	Alarm Low 1
`AL.h 1`	Alarm High 1
`AL.E 1`	Alarm Error 1
`Er.1 1`	Error Input 1
`tUn 1`	Tuning
`rP 1`	Ramping

Upon power up of the control, using the advance key will scroll through the various prompts found in the Operations Menu. At any point within the Operations menu to return to the default display push the Infinity ⚭ key.

Operations Menu

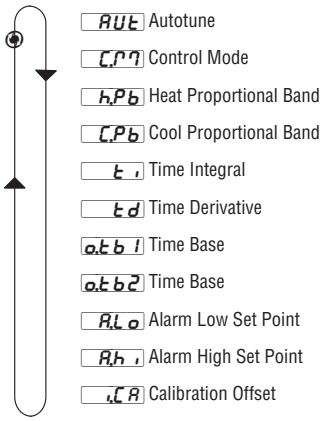

Operations Menu

16th & 32nd DIN PID Controller

Display	*Parameter Name Description*	*Range* (Defaults are shown bold)
AUt [AUt]	***Autotune*** Start an autotune. While active the upper or left and lower or right display will flash tUn1 and AtEn. Appears if: Heat or cool algorithm set to PID	**no No** YES Yes
Cm [C.M]	***Control Mode Active*** View the current control mode. Appears if: Always	oFF Off **Auto Auto** Mman Manual
h.Pb [h.Pb]	***Heat Proportional Band*** Set the PID proportional band for the heat outputs. Appears if: Heat algorithm set to PID	0 to 9,999.000°F or units 0 to 5,555.000°C **Units, 25.0°F or 14.0°C**
C.Pb [C.Pb]	***Cool Proportional Band*** Set the PID proportional band for the cool outputs. Appears if: Cool algorithm set to PID	0 to 9,999.000°F or units 0 to 5,555.000°C **Units, 25.0°F or 14.0°C**
ti [ti]	***Time Integral*** Set the PID integral for the outputs. Appears if: Heat or cool algorithm set to PID	0 to 9,999 seconds per repeat **180.0**
td [td]	***Time Derivative*** Set the PID derivative time for the outputs. Appears if: Heat or cool algorithm set to PID	0 to 9,999 seconds **0.0 seconds**
o.tb1 [o.tb1]	***Time Base Output 1*** Set the time base for fixed-time-base control. Appears if: Output 1 set to heat or cool with control algorithm set to PID.	0.1 to 60.0 seconds (solid-state relay or switched dc) 5.0 to 60.0 seconds (mechanical relay & NO-ARC power control) **1 sec. [SSR & sw dc], 20.0 sec. [mech. relay & NO-ARC]**
o.tb2 [o.tb2]	***Time Base Output 2*** Set the time base for fixed-time-base control. Appears if: Output 2 set to heat or cool with control algorithm set to PID.	0.1 to 60.0 seconds (solid-state relay or switched dc) 5.0 to 60.0 seconds (mechanical relay & NO-ARC power control) **1 sec. [SSR & sw dc], 20.0 sec. [mech. relay & NO-ARC]**
A.Lo [A.Lo]	***Alarm Low Set Point*** Process - set the process value that will trigger a low alarm. Deviation - set the span of units from the closed loop set point that will trigger a low alarm. Appears if: If Alarm Type (A.ty) is set to Process or Deviation Alarm	-1,999.000 to 9,999.000°F or units -1,128.000 to 5,537.000°C **Units, 32.0°F or 0.0°C**
A.hi [A.hi]	***Alarm High Set Point*** Process - set the process value that will trigger a high alarm. Deviation - set the span of units from the closed loop set point that will trigger a high alarm. Appears if: If Alarm Type (A.ty) is set to Process or Deviation Alarm	-1,999.000 to 9,999.000°F or units -1,128.000 to 5,537.000°C **Units, 300.0°F or 150.0°C**
i.CA [i.CA]	***Calibration Offset*** Set an offset value for a process output. Appears if: Always	-1,999.000 to 9,999.000°F or units -1,110.555 to 5,555.000°C **0.0**

To enter the Setup Menu push and hold the up and down arrow keys for approximately 3 seconds. Once there, push the green advance key to scroll through to the prompt of choice and then use the up and down arrow keys to change the range. At any point within the Setup menu to return to the default display push the Infinity ⚭ key.

Setup Menu

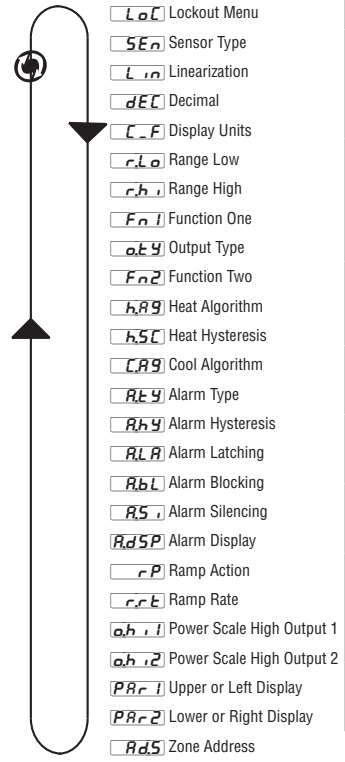

Setup Menu

16th & 32nd DIN PID Controller

Display	*Parameter Name Description*	*Range* (Defaults are shown bold)
LoC [LoC]	***Lockout Menu*** Set the security clearance level. The user can access the selected level and all lower levels. Appears if: Always	1 to 5 1 Operations Menu (read only, A/M button disabled)* 2 Operations Menu (A/M button disabled, Set point R/W)* 3 Operations Menu (A/M button enabled, Set point R/W, Control Mode R/W)* 4 Operations Menu R/W access* **5 Operations Menu and Setup Menu full R/W access** *You can change the security level at any level
SEn [SEn]	***Sensor Type*** Set the analog sensor type to match the device wired to this input. Appears if: Always	**tC Thermocouple** volt Volts dc mAmp Milliamps dc rtd Rtd RTD 100 Ω
Lin [Lin]	***Linearization*** Set the linearization to match the thermocouple type wired to this input. For example, select H for a type K thermocouple. Appears if: Sensor Type is set to Thermocouple.	**J J** H K n N S S t T
dEC [dEC]	***Decimal*** Set the precision of the displayed value. Appears if: Always	**0 Whole** 0.0 Tenths 0.00 Hundredths
C_F [C_F]	***Display Units*** Select which units will be displayed. Appears if: Always	**F °F** C °C
r.Lo [r.Lo]	***Range Low*** Set the low range of the set point. Appears if: Always	-1,999.000 to 9,999.000 **0.0**
r.hi [r.hi]	***Range High*** Set the high range of the set point. Appears if: Always	-1,999.000 to **9,999.000**
Fn1 [fn1]	***Function of Output 1*** Select which function will drive this output. Appears if: If output 1 is ordered	**oFF Off** Cool Cool HEAt Heat ALM Alarm
o.ty [o.ty]	***Output Type*** Select whether the process output will operate in volts or milliamps. Appears if: A process output (PM _ C _ F _-_ AAAB _ _)	**volt Volts** mAmp Milliamps

To enter the Setup Menu push and hold the up and down arrow keys for approximately 3 seconds. Once there, push the green advance key to scroll through to the prompt of choice and then use the up and down arrow keys to change the range. At any point within the Setup menu to return to the default display push the Infinity ∞ key.

Setup Menu

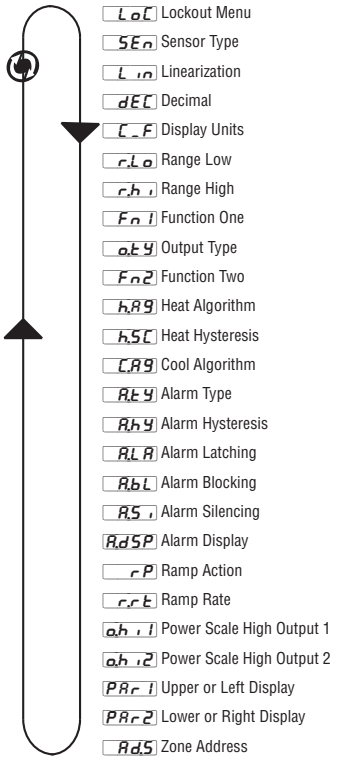

Setup Menu
16th & 32nd DIN PID Controller

Display	*Parameter Name Description*	*Range* (Defaults are shown bold)
Fn2 [fn2]	***Function of Output 2*** Select which function will drive this output. Appears if: If output 2 is ordered	oFF **Off** CooL Cool hEAt Heat ALrM Alarm
h.Ag [h.Ag]	***Heat Algorithm*** Set the heat control method. Appears if: Output 1 or 2 set to heat	oFF Off P_id **PID** on.oF On-Off
h.SC [hSC]	***Hysteresis (Heat & Cool)*** Set the control switching hysteresis for on-off control. This determines how far into the "on" region the process value needs to move before the output turns on. Appears if: Heat or Cool Algorithm is set to On-Off.	0 to 9,999.000°F or units 0 to 5,555.000°C **Units, 3.0°F or 2.0°C**
C.Ag [C.Ag]	***Cool Algorithm*** Set the cool control method. Appears if: If Output 1 or 2 is set to cool	oFF **Off** P_id PID on.oF On-Off
A.tY [A.ty]	***Alarm Type*** Select how the alarm will or will not track the set point. Appears if: Always	oFF **Off** Pr.AL Process Alarm dE.AL Deviation Alarm
A.hY [A.hy]	***Alarm Hysteresis*** Set the hysteresis for an alarm. This determines how far into the safe region the process value needs to move before the alarm can be cleared. Appears if: When alarm type is set to process or deviation alarm	0.001 to 9,999.000°F or units 0.001 to 5,555.000°C **Units, 1.0°F or 1.0°C**
A.LA [A.LA]	***Alarm Latching*** Turn alarm latching on or off. A latched alarm has to be turned off by the user. Appears if: When alarm type is set to process or deviation alarm	nLAt **Non-Latching** LAt Latching
A.bL [A.bL]	***Alarm Blocking*** Select when an alarm will be blocked. After startup and/or after the set point changes, the alarm will be blocked until the process value enters the normal range. Appears if: When alarm type is set to process or deviation alarm	oFF **Off** Str Startup SEPt Set Point both Both
A.Si [A.Si]	***Alarm* Silencing** Turn alarm silencing on to allow the user to disable the output tied (configured) to this alarm Appears if: When alarm type is set to process or deviation alarm	oFF **Off** on On
A.dSP [A.dSP]	***Alarm Display*** Display an alarm message when an alarm is active. Appears if: When alarm type is set to process or deviation alarm	oFF Off on **On**

To enter the Setup Menu push and hold the up and down arrow keys for approximately 3 seconds. Once there, push the green advance key to scroll through to the prompt of choice and then use the up and down arrow keys to change the range. At any point within the Setup menu to return to the default display push the Infinity ∞ key.

Setup Menu

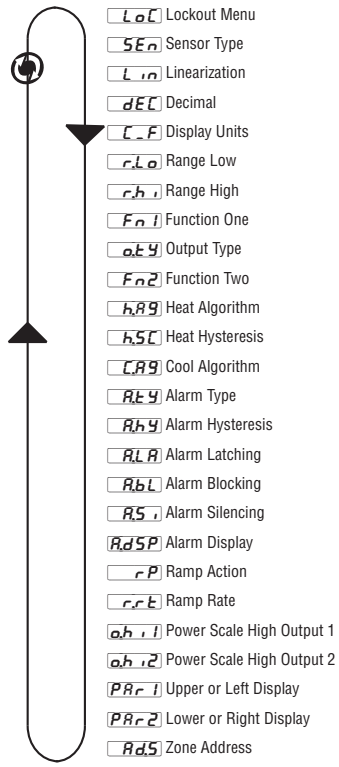

Setup Menu
16th & 32nd DIN PID Controller

Display	*Parameter Name Description*	*Range* (Defaults are shown bold)
rP [rP]	***Ramp Action*** Select when the controller's set point will ramp to the defined end set point. Appears if: Always	oFF **Off** Str Startup SEPt Set Point Change both Both
r.rt [r.rt]	***Ramp Rate*** Set the rate for the set point ramp. Set the time units for the rate with the Ramp Scale parameter. Appears if: Ramp Action is set to Startup, Set Point or Both.	**1.0**°F degrees or units per hour **1.0**°C
o.hi1 [o.hi1]	***Power Scale Output High 1*** Set maximum value of output 1 range. Appears if: Output 1 is set to heat	0.0 to 100% **100.0**
o.hi2 [o.hi2]	***Power Scale Output High 2*** Set maximum value of output 2 range. Appears if: Output 2 is set to heat	0.0 to 100% **100.0**
PAr1 [PAr1]	***Upper or Left Display*** Select parameter to display. Appears if: Always	AC.Pu **Active Process Value** none none
PAr2 [PAr2]	***Lower or Right Display*** Select parameter to display. Appears if: Always	AC.SP **Active Set Point** Ah_1 Alarm High Set Point AL_o Alarm Low Set Point none None
Ad.S [Ad.S]	***Zone Address - Standard Bus Communication*** Set zone address from 1-16. Appears if: Always	1-16 **1**

Specifications

Line Voltage/Power
- All voltage levels represent minimums and maximums
- 85 to 264V~(ac), 47 to 63Hz
- 20 to 28V~(ac), +10/-15 percent; 50/60Hz, ±5 percent
- 12 to 40V⎓(dc)
- 10VA maximum power consumption
- Data retention upon power failure via nonvolatile memory
- Compliant with SEMI F47-0200, Figure R1-1 voltage sag requirements @ 24V~(ac) or higher

Environment
- -18 to 65°C (0 to 149°F) operating temperature
- -40 to 85°C (-40 to 185°F) storage temperature
- 0 to 90 percent RH, non-condensing

Accuracy
- Calibration accuracy and sensor conformity: ±0.1 percent of span, ±1°C @ the calibrated ambient temperature and rated line voltage
  - Type S, 0.2 percent
  - Type T, below -50°C; 0.2 percent
- Calibration ambient temperature @ 25°C ±3°C (77°F ±5°F)
- Accuracy span: 540°C (1000°F) minimum
- Temperature stability: ±0.1°C/°C (±0.1°F/°F) rise in ambient maximum

Agency Approvals
- UL®/EN 61010 Listed
- ANSI/ISA 12.12.01-2007 Class 1 Division 2 Groups A, B, C, D, Temperature Code T4A.
- UL® 50, NEMA 4X, EN 60529 IP66
- CSA C22.2 No. 24 File 158031
- RoHS, W.E.E.E.
- SEMI F47-0200

Controller
- User selectable heat/cool, on-off, P, PI, PD, PID or alarm action
- Auto-tune control algorithm
- Control sampling rates: input = 10Hz, outputs = 10Hz
- Input and output capacity per controller type ordering information

Serial Communications
- Isolated communications
- Standard Bus Configuration Protocol

Wiring Termination—Touch-Safe Terminals
- Input, power and controller output terminals are touch safe removable 12 to 22 AWG
- Use 75°C, Cu conductor only

Universal Input
- Thermocouple, grounded or ungrounded sensors
- >20MΩinput impedance
- Maximum of 2KΩ source resistance
- RTD 2- or 3-wire, platinum, 100Ω @ 0°C calibration to DIN curve (0.00385 Ω/Ω/°C)
- Process, 4-20mA @ 100Ω, or 0-10V⎓(dc) @ 20kΩ input impedance; scalable

Functional Operating Range
- Type J: -210 to 1200°C (-346 to 2192°F)
- Type K: -200 to 1370°C (-328 to 2500°F)
- Type N: -200 to 1300°C (-328 to 2372°F)
- Type S: -50 to 1767°C (-58 to 3214°F)
- Type T: -200 to 400°C (-328 to 750°F)
- RTD (DIN): -200 to 800°C (-328 to 1472°F)
- Process: -1999 to 9999 units

Output Hardware
- Switched dc, 22 to 32V⎓(dc) with a maximum of 40 mA supply current available.
- Open collector, maximum sink current 100 mA, @ 30V⎓(dc)
- Solid state relay (SSR), Form A, 0.5A @ 24V~(ac) minimum, 264V~(ac) maximum, opto-isolated, without contact suppression
- Electromechanical relay, Form C, 5A, 24 to 240V~(ac) or 30V⎓(dc) maximum, resistive load, 100,000 cycles at rated load
- Electromechanical relay, Form A, 5A, 24 to 240V~(ac) or 30V⎓(dc) maximum, resistive load, 100,000 cycles at rated load
- NO-ARC relay, Form A, 15A, 24 to 240V~(ac), no V⎓(dc), resistive load, 2 million cycles at rated load
- Universal process:
  - 0 to 10V⎓(dc) into a minimum 1,000Ω load
  - 4 to 20mA into maximum 800Ω load

Operator Interface
- Dual 4 digit, 7 segment LED displays
- Typical display update rate 1Hz
- Advance, infinity, up and down keys plus an EZ-KEY key (not available in 1⁄32 DIN)
- EZ-KEY automatically programmed as an Auto/Manual transfer mode function.

Ordering Part Number (Part number digits 1 through 14) PMX**C**XXX-AAAA**B**XX

All Models include: *Universal Sensor Input, Standard Bus Configuration Communications
*Dual line Red over Green 7 Segment displays

Package Size (**Digit #3**)
3 = 1/32 DIN
6 = 1/16 DIN
8 = 1/8 DIN vertical (future option)
9 = 1/8 DIN horizontal (future option)
4 = 1/4 DIN (future option)

Primary Function (**Digit #4**)
C = PID Controller w/ Universal Input

Power Supply (**Digit #5**)
1 = 100-240 VAC
3 = 12-28VAC/DC

Output 1 and 2 Hardware Options (**Digits #6 and #7**)

	Output 1	Output 2
CA =	Switched dc/open collector	None
CH =	Switched dc/open collector	NO-ARC 15 Amp power control
CC =	Switched dc/open collector	Switched DC
CJ =	Switched dc/open collector	Mechanical relay 5A, Form A
CK =	Switched dc/open collector	SSR Form A, 0.5 Amp
EA =	Mechanical Relay 5 Amp form C	None
EH =	Mechanical Relay 5 Amp form C	NO-ARC 15 Amp power control
EC =	Mechanical Relay 5 Amp form C	Switched DC
EJ =	Mechanical Relay 5 Amp form C	Mechanical relay 5A, Form A
EK =	Mechanical Relay 5 Amp form C	SSR Form A, 0.5 Amp
FA =	Universal Process	None
FC =	Universal Process	Switched DC
FJ =	Universal Process	Mechanical relay 5A, Form A
FK =	Universal Process	SSR Form A, 0.5 Amp
AK =	None	SSR Form A, 0.5 Amp
KK =	SSR Form A, 0.5 Amp	SSR Form A, 0.5 Amp

Future Options (**Digits #8 thru #11**)
AAAA = None

Menu Type (**Digits #12**)
B = PM Express with English manual (Limit or PID)

Additional Options (**Digits #13 and #14**)
AA = Standard EZ-ZONE face plate
12 = Class 1, Div 2 (not available with Limit Controller or mechanical relay outputs)

Multilingual User Manuals (PID only) and associated Watlow part numbers:

- English	0600-0065-0000
- Chinese	0600-0065-0001
- Japanese	0600-0065-0002
- Korean	0600-0065-0003
- German	0600-0065-0004
- French	0600-0065-0005
- Italian	0600-0065-0006
- Spanish	0600-0065-0007

Declaration of Conformity

Series PM

CE

Watlow Winona, Inc.
1241 Bundy Blvd.
Winona, MN 55987 USA

Declares that the following product:

Designation:	**Series PM (Panel Mount)**
Model Numbers:	PM (3 or 6)(Any Letter or number) – (1, 2, 3 or 4)(A, C, E, F or K)(A, C, H, J or K)(Any letter or number) – (Any letter or number)(A, C, E, F or K)(A, D, J or K) (Any three letters or numbers)
Classification:	Temperature control, Installation Category II, Pollution degree 2
Rated Voltage and Frequency:	100 to 240 V~ (ac 50/60 Hz) **or** 15 to 36 Vdc/ 24 Vac 50/60 Hz
Rated Power Consumption:	10 VA maximum

Meets the essential requirements of the following European Union Directives by using the relevant standards show below to indicate compliance.

2004/108/EC Electromagnetic Compatibility Directive

EN 61326-1	**2006**		**Electrical equipment for measurement, control and laboratory use – EMC requirements (Industrial Immunity, Class B Emissions).**
EN 61000-4-2	1996	A1, A2, 2001	Electrostatic Discharge Immunity
EN 61000-4-3	2006		Radiated Field Immunity
EN 61000-4-4	2004		Electrical Fast-Transient / Burst Immunity
EN 61000-4-5	2006		Surge Immunity
EN 61000-4-6	1996	A1, 2, 3, 2005	Conducted Immunity
EN 61000-4-11	2004		Voltage Dips, Short Interruptions and Voltage Variations Immunity
EN 61000-3-2	2006		Harmonic Current Emissions
IEC 61000-3-3[1]	2005		Voltage Fluctuations and Flicker

[1]For mechanical relay loads, cycle time may need to be extended up to 150 seconds to meet flicker requirements depending on load switched and source impedance.

2006/95/EC Low-Voltage Directive

EN 61010-1	**2001**	**Safety Requirements of electrical equipment for measurement, control and laboratory use. Part 1: General requirements**

Raymond D. Feller III
Name of Authorized Representative

Winona, Minnesota, USA
Place of Issue

General Manager
Title of Authorized Representative

December 2008
Date of Issue

Signature of Authorized Representative

How to Reach Us

Corporate Headquarters
Watlow Electric Manufacturing Company
12001 Lackland Road
St. Louis, MO 63146
Sales: 1-800-WATLOW2
Manufacturing Support: 1-800-4WATLOW
Email: info@watlow.com
Website: www.watlow.com
From outside the USA and Canada:
Tel: +1 (314) 878-4600
Fax: +1 (314) 878-6814

Latin America
Watlow de México S.A. de C.V.
Av. Fundición No. 5
Col. Parques Industriales
Querétaro, Qro. CP-76130
Mexico
Tel: +52 442 217-6235
Fax: +52 442 217-6403

Europe
Watlow France SARL
Immeuble Somag
16, Rue Ampère
95307 Cergy-Pontoise CEDEX
France
Tel: + 33 (0)1 30 73 24 25
Fax: + 33 (0)1 30 73 28 75
Email: info@watlow.fr
Website: www.watlow.fr

Watlow GmbH
Postfach 11 65, Lauchwasenstr. 1
D-76709 Kronau
Germany
Tel: +49 (0) 7253 9400-0
Fax: +49 (0) 7253 9400-900
Email: info@watlow.de
Website: www.watlow.de

Watlow Italy S.r.l.
Viale Italia 52/54
20094 Corsico MI
Italy
Tel: +39 024588841
Fax: +39 0245869954
Email: italyinfo@watlow.com
Website: www.watlow.it

Watlow Ibérica, S.L.U.
C/Marte 12, Posterior, Local 9
E-28850 Torrejón de Ardoz
Madrid - Spain
T. +34 91 675 12 92
F. +34 91 648 73 80
Email: info@watlow.es
Website: www.watlow.es

Watlow
Storgatan 24
302 43 Halmstad
Sweden
Tel: + 46 (0)35 27 11 66
Fax: +46 (0)35 27 11 67
Email: info@watlow.se
Website: www.watlow.se

Watlow UK Ltd.
Linby Industrial Estate
Linby, Nottingham, NG15 8AA
United Kingdom
Telephone: (0) 115 964 0777
Fax: (0) 115 964 0071
Email: info@watlow.co.uk
Website: www.watlow.co.uk
From outside The United Kingdom:
Tel: +44 115 964 0777
Fax: +44 115 964 0071

Asia and Pacific
Watlow Singapore Pte Ltd.
16 Ayer Rajah Crescent,
#06-03/04,
Singapore 139965
Tel: +65 6773 9488 Fax: +65 6778 0323
Email: info@watlow.com.sg Website:www.watlow.com.sg

Watlow Australia Pty., Ltd.
4/57 Sharps Road
Tullamarine, VIC 3043
Australia
Tel: +61 3 9335 6449
Fax: +61 3 9330 3566
Website: www.watlow.com

Watlow Electric Manufacturing (Shanghai) Company
1118 Fangyuan Road, Anting Industrial Park, Jiading, Shanghai, PRC 201203
People's Republic of China
Tel: +86 21 39509510 Fax: +86 21 5080-0906
Email: info@watlow.cn Website: www.watlow.cn

ワトロー・ジャパン株式会社
〒101-0047 東京都千代田区内神田1-14-4
四国ビル別館9階
Tel: 03-3518-6630 Fax: 03-3518-6632
Email: infoj@watlow.com Website: www.watlow.co.jp

Watlow Japan Ltd.
1-14-4 Uchikanda, Chiyoda-Ku
Tokyo 101-0047
Japan
Tel: +81-3-3518-6630 Fax: +81-3-3518-6632
Email: infoj@watlow.com Website: www.watlow.co.jp

Watlow Korea Co., Ltd.
#1406, E&C Dream Tower, 46, Yangpyeongdong-3ga
Yeongdeungpo-gu, Seoul 150-103
Republic of Korea
Tel: +82 (2) 2628-5770 Fax: +82 (2) 2628-5771
Website: www.watlow.co.kr

Watlow Malaysia Sdn Bhd
No. 14-3 Jalan 2/114
Kuchai Business Centre
Jalan Kuchai Lama
58200 Kuala Lumpur
Malaysia
Tel: +60 3 7980 7741 Fax: +60 3 7980 7739

瓦特龍電機股份有限公司
80143 高雄市前金區七賢二路189號 10樓之一
電話: 07-2885168 傳真: 07-2885568

Watlow Electric Taiwan Corporation
10F-1 No.189 Chi-Shen 2nd Road Kaohsiung 80143
Taiwan
Tel: +886-7-2885168 Fax: +886-7-2885568

Your Authorized Watlow Distributor

TOTAL CUSTOMER SATISFACTION
3 Year Warranty